

(12) 特許協力条約に基づいて公開された国際出願

(19) 世界知的所有権機関
国際事務局

(43) 国際公開日
2021年6月3日(03.06.2021)




(10) 国際公開番号
WO 2021/106959 A1


- (51) 国際特許分類:
F24F 11/54 (2018.01) *F24F 11/64* (2018.01)
F24F 11/58 (2018.01)
- (21) 国際出願番号: PCT/JP2020/043899
- (22) 国際出願日: 2020年11月25日(25.11.2020)
- (25) 国際出願の言語: 日本語
- (26) 国際公開の言語: 日本語
- (30) 優先権データ:
特願 2019-213229 2019年11月26日(26.11.2019) JP
- (71) 出願人: ダイキン工業株式会社 (DAIKIN INDUSTRIES, LTD.) [JP/JP]; 〒5308323 大阪府
- 大阪市北区中崎西2丁目4番12号梅田センタービル Osaka (JP).
- (72) 発明者: 岡田 良平 (OKADA, Ryohei). 文元 拓哉 (FUMIMOTO, Takuya). 野村 佳秀 (NOMURA, Yoshihide).
- (74) 代理人: 新樹グローバル・アイピー特許業務法人 (SHINJYU GLOBAL IP); 〒5300054 大阪府大阪市北区南森町1丁目4番19号サウスホレストビル Osaka (JP).
- (81) 指定国(表示のない限り、全ての種類の国内保護が可能): AE, AG, AL, AM, AO, AT, AU, AZ, BA, BB, BG, BH, BN, BR, BW, BY, BZ, CA, CH, CL, CN, CO, CR, CU, CZ, DE, DJ, DK, DM, DO, DZ, EC, EE, EG, ES, FI, GB, GD, GE, GH, GM, GT,

(54) Title: AIR-CONDITIONING MANAGEMENT SYSTEM

(54) 発明の名称: 空調管理システム

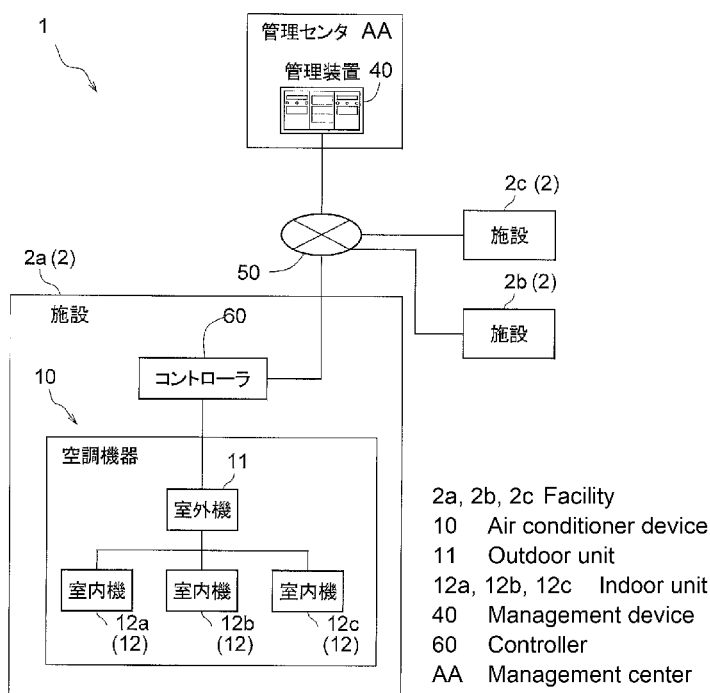

(57) Abstract: When a management program is created on the basis of information specific to an air conditioner device, sufficient management using a current management program may not be possible when a new air conditioner device is introduced to an air-conditioning management system. The air-conditioning management system (1) is a system for managing a plurality of air conditioner devices (10) to be managed. The air-conditioning management system (1) is provided with a controller (60) and a server device (40). The controller (60) is connected to the air conditioner devices (10). The



WO 2021/106959 A1

HN, HR, HU, ID, IL, IN, IR, IS, IT, JO, KE, KG, KH,
KN, KP, KR, KW, KZ, LA, LC, LK, LR, LS, LU, LY,
MA, MD, ME, MG, MK, MN, MW, MX, MY, MZ,
NA, NG, NI, NO, NZ, OM, PA, PE, PG, PH, PL, PT,
QA, RO, RS, RU, RW, SA, SC, SD, SE, SG, SK, SL,
ST, SV, SY, TH, TJ, TM, TN, TR, TT, TZ, UA, UG,
US, UZ, VC, VN, WS, ZA, ZM, ZW.

- (84) 指定国(表示のない限り、全ての種類の広域保護が可能): ARIPO (BW, GH, GM, KE, LR, LS, MW, MZ, NA, RW, SD, SL, ST, SZ, TZ, UG, ZM, ZW), ユーラシア (AM, AZ, BY, KG, KZ, RU, TJ, TM), ヨーロッパ (AL, AT, BE, BG, CH, CY, CZ, DE, DK, EE, ES, FI, FR, GB, GR, HR, HU, IE, IS, IT, LT, LU, LV, MC, MK, MT, NL, NO, PL, PT, RO, RS, SE, SI, SK, SM, TR), OAPI (BF, BJ, CF, CG, CI, CM, GA, GN, GQ, GW, KM, ML, MR, NE, SN, TD, TG).

添付公開書類 :

- 一 国際調査報告 (条約第21条(3))

controller (60) executes a management program (3) for managing the air conditioner devices (10). The server device is connected to the controller (60). The server device (40) provides an air conditioner data model (4) to the controller (60). The air conditioner data model (4) is a collection of data for the air conditioner devices (10) referenced by the management program (3).

(57) 要約 : 空調機器に特有の情報に基づいて管理プログラムを作成すると、空調管理システムに新しい空調機器が導入されたとき、現行の管理プログラムでは十分に管理を行う事ができない場合がある。空調管理システム (1) は、管理対象となる複数の空調機器 (10) を管理するシステムである。空調管理システム (1) は、コントローラ (60) と、サーバ装置 (40) と、を備える。コントローラ (60) は、空調機器 (10) に接続される。コントローラ (60) は、空調機器 (10) を管理するための管理プログラム (3) を実行する。サーバ装置 (40) は、コントローラ (60) に接続される。サーバ装置 (40) は、コントローラ (60) に対して、空調機データモデル (4) を提供する。空調機データモデル (4) は、管理プログラム (3) によって参照される空調機器 (10) のデータの集合体である。

DESCRIPTION

AIR-CONDITIONING MANAGEMENT SYSTEM

TECHNICAL FIELD

The present disclosure relates to an air conditioning management system that manages
5 a plurality of air conditioners as management targets.

BACKGROUND ART

There has been provided an air conditioning management system for comprehensively
managing (monitoring, controlling, and the like) air conditioners such as an outdoor unit and
an indoor unit. In such an air conditioning management system, a data center connected to a
10 network such as the Internet or a public network provides a controller with a management
program, and the controller executes the management program (Patent Literature 1: JP 2004-
234176 A). The management program in Patent Literature 1 is selected in accordance with
device information as information unique to an air conditioner and is provided from the data
center.

15 SUMMARY OF THE INVENTION

<Technical Problem>

A different program for management of an air conditioner may be applied to each air
conditioner as a management target. In an exemplary case where a new air conditioner is
introduced, the existing management program included in the controller may fail to achieve
20 sufficient management. Patent Literature 1 needs development of a corresponding
management program for management of a newly introduced air conditioner. Development
of a management program problematically requires enormous work time and processes.

<Solution to Problem>

An air conditioning management system according to a first aspect is configured to
25 manage a plurality of air conditioners as management targets. The air conditioning
management system includes a controller and a server apparatus. The controller is connected
to the air conditioners. The controller executes a management program for management of
the air conditioners. The server apparatus is connected to the controller. The server
apparatus provides the controller with an air conditioner data model. The air conditioner data
30 model is a collection of data on the air conditioners to be referred to in the management
program.

In the air conditioning management system according to the first aspect, the server
apparatus provides the air conditioner data model to enable management with use of an
identical management program even when a new air conditioner is introduced.

An air conditioning management system according to a second aspect is the system according to the first aspect, in which the controller is connected to the server apparatus via a network.

5 An air conditioning management system according to a third aspect is the system according to the first or second aspect, in which the air conditioner data model is provided for each type of the air conditioners.

The air conditioning management system can thus manage a new type of the air conditioners introduced to the air conditioning management system with use of the identical management program.

10 An air conditioning management system according to a fourth aspect is the system according to any of the first to third aspects, in which when the air conditioner data model is registered at the server apparatus, the server apparatus provides the controller with the air conditioner data model.

15 An air conditioning management system according to a fifth aspect is the system according to any of the first to third aspects, in which the air conditioner data model includes information on a conversion function for interconversion between data acquired from the air conditioners and data recognizable by the server apparatus.

The controller and the server apparatus can thus achieve data conversion in a recognizable language.

20 An air conditioning management system according to a sixth aspect is the system according to any of the first to fifth aspects, in which the air conditioner data model includes information on a conversion function for interconversion between data acquired from the air conditioners and data recognizable by the server apparatus.

BRIEF DESCRIPTION OF THE DRAWINGS

25 FIG. 1 is a schematic view depicting a configuration of an air conditioning management system.

FIG. 2 is a schematic view depicting a configuration of an air conditioner.

FIG. 3 is a schematic view depicting functional blocks of devices constituting the air conditioning management system.

30 FIG. 4 indicates an exemplary air conditioner data model.

FIG. 5 indicates another exemplary air conditioner data model.

FIG. 6 indicates still another exemplary air conditioner data model.

DESCRIPTION OF EMBODIMENTS

(1) Entire configuration

FIG. 1 is a schematic view depicting a configuration of an air conditioning management system 1. When a plurality of devices having similar functions are commonly described below, identical reference signs will be denoted. An English lower-case subscript will be added to distinguished description of one of the devices having similar functions. For example, indoor units 12a, 12b, and 12c have similar functions, and will be each called an indoor unit 12 without using a subscript a, b, and c for common description.

The air conditioning management system 1 includes an air conditioner 10 as a management target, a controller 60 that executes a management program 3 for management of the air conditioner 10, and a server apparatus 40 that provides an air conditioner data model 4 to be referred to in the management program 3 and manages the air conditioner 10.

The server apparatus 40 herein is installed in a central management center. The server apparatus 40 is connected to a communication network 50 such as the Internet. The server apparatus 40 is connected with a plurality of facilities 2 (2a to 2c). Examples of the facilities 2 include an office building, a commercial building, and a condominium. Each of the facilities 2 is provided with, as management targets, one or a plurality of air conditioners 10 that execute cooling operation or heating operation in the facility 2. The air conditioner 10 includes an outdoor unit 11, and one or a plurality of indoor units 12 (12a, 12b, and 12c). The air conditioner 10 is connected with the controller 60. The controller 60 is connected to the server apparatus 40 via the communication network 50 such as the Internet.

In the air conditioning management system 1, the controller 60 executes the management program 3 to manage the air conditioner 10. Management herein indicates monitoring, operating, or the like of the air conditioner 10. The controller 60 executes the management program 3 in accordance with the air conditioner data model 4 to acquire predetermined data from the air conditioner 10. The air conditioner data model 4 is a collection of data on the air conditioner 10 (the outdoor unit 11 or the indoor unit 12). The air conditioner data model 4 is prepared for each type by a manager or the like of the air conditioning management system 1, and is registered at the server apparatus 40. When the air conditioner data model 4 is registered at the server apparatus 40, the server apparatus 40 provides the controller 60 with the air conditioner data model 4. The air conditioning management system 1 can thus manage a new type of the air conditioner 10.

(2) Air conditioner as management target

FIG. 2 is a schematic view depicting a configuration of the air conditioner 10. As described above, the air conditioner 10 as the management target of the air conditioning management system 1 includes the outdoor unit 11, and the one or the plurality of indoor units

12. The outdoor unit 11 is disposed on a roof, in a basement, or the like. The indoor units 12 are dispersedly installed on a plurality of floors, in a plurality of rooms, or the like of the facilities 2.

5 The outdoor unit 11 includes a compressor 21, an outdoor heat exchanger 23, an outdoor fan 24, a sensor 25, an outdoor unit controlling unit 11X, and the like. Each of the indoor units 12a, 12b, and 12c includes an indoor heat exchanger 33, an indoor fan 34, a sensor 35, an indoor unit controlling unit 12X (12Xa, 12Xb, and 12Xc), and the like. The outdoor unit 11 (the outdoor unit controlling unit 11X) and the indoor unit 12 (the indoor unit controlling unit 12X) are connected to each other via a dedicated communication line. The outdoor unit controlling unit 11X and the indoor unit controlling unit 12X cooperatively control operation of each unit in the air conditioner 10 in accordance with detection values of the sensors 25 and 35 or the like. The server apparatus 40 collects, via the communication network 50, data on the outdoor unit 11 and the indoor unit 12 from the outdoor unit controlling unit 11X and the indoor unit controlling unit 12X. The outdoor unit controlling unit 11X transmits and receives the data on the outdoor unit 11 and the indoor unit 12 to and from the controller 60. The air conditioner 10 is managed in accordance with a command inputted to the controlling units 11X and 12X from a remote controller or the like attached to each of the indoor units 12 or via the communication network 50, the server apparatus 40, and the controller 60.

20 (3) Detailed configuration of air conditioner management system

FIG. 3 is a schematic view depicting functional blocks of devices constituting the air conditioning management system 1.

(3-1) Controller

25 The controller 60 is connected to the outdoor unit controlling unit 11X of the outdoor unit 11 to manage the air conditioner 10. The controller 60 is a computer for managing the air conditioner 10, and is exemplarily called a gateway or an edge. The controller 60 may be constituted by a plurality of computers and devices connected via a network. The controller 60 includes a storage unit 61, a communication unit 62, a processing unit 63a, and a connecting unit 64.

30 The storage unit 61 is configured to store various information, and may include a ROM, a RAM, and/or a hard disk, etc. The storage unit 61 stores various programs for execution of various functions of the controller 60, and various data for execution of the programs. Specifically, the storage unit 61 stores the management program 3 for management of the air conditioner 10, the air conditioner data model 4 (to be described later) to be referred

to in the management program 3, and a conversion function for data conversion. The management program 3 may be provided from the server apparatus 40 via the communication unit 62 to be described later, or may be preliminarily included in the controller 60. The conversion function is used for interconversion between data recognizable by the air conditioner 10 and data recognizable by the server apparatus 40. The air conditioner data model 4 is linked with information on the conversion function for conversion of each piece of data, and the controller 60 uses the conversion function to process data interconversion.

The communication unit 62 is an interface or the like for communication with the communication network 50 via a public network, a router, or the like (not depicted). The communication unit 62 is functioned to achieve communication between the controller 60 and the server apparatus 40, of data on the air conditioner 10 including various commands. The controller 60 receives the air conditioner data model 4 from the server apparatus 40 via the communication unit 62.

A control unit 63 is constituted by a CPU, a cache memory, and the like. The control unit 63 cooperates with remaining constituents of the controller 60 to control the entire controller 60. The control unit 63 includes the processing unit 63a that processes various information in the controller 60. For example, the processing unit 63a acquires data from the outdoor unit 11 and the indoor unit 12 via the connecting unit 64 to store the data in the storage unit 61. The processing unit 63a processes, with use of the conversion function, interconversion between data recognizable by the air conditioner 10 and data recognizable by the server apparatus 40. The processing unit 63a causes the communication unit 62 to transmit various commands received from the server apparatus 40 to the outdoor unit 11 and the indoor unit 12 at predetermined timing.

The connecting unit 64 is an interface to be connected to the outdoor unit controlling unit 11X. The controller 60 can thus transmit various commands to the outdoor unit controlling unit 11X and receive data from the outdoor unit controlling unit 11X via the connecting unit 64.

(3-2) Server apparatus

The server apparatus 40 is connected to the controller 60 via the communication network 50 to manage the air conditioner 10. The server apparatus 40 is a computer that manages the air conditioner 10, such as a supercomputer, a workstation, a personal computer, or cloud computing. The server apparatus 40 includes a storage unit 41, a communication unit 42, a processing unit 43a, an input unit 45, and an output unit 46.

The storage unit 41 is configured to store various information, and includes a ROM,

a RAM, and/or a hard disk, etc. For example, the storage unit 41 stores various programs for execution of various functions of the server apparatus 40, and various data for execution of the programs. Specifically, the storage unit 41 stores the management program 3, and the air conditioner data model 4 to be referred to in the management program 3. The air conditioner data model 4 is stored (registered) at the storage unit 41 via the input unit 45 to be described later or the communication unit 42 to be described later. When the air conditioner data model 4 is registered at the storage unit 41 of the server apparatus 40, the processing unit 43a provides the air conditioner data model 4 to the controller 60 via the communication unit 42.

The communication unit 42 is an interface or the like for communication with the controller 60 and the like via a public network, a router, or the like (not depicted). Specifically, the communication unit 42 executes communication with the controller 60, of data on the air conditioner 10 including various commands.

A control unit 43 is constituted by a CPU, a cache memory, and the like. The control unit 43 cooperates with remaining constituents of the server apparatus 40 to control the entire server apparatus 40. The control unit 43 includes the processing unit 43a that processes various information in the server apparatus 40. For example, the processing unit 43a stores, in the storage unit 41, data on the air conditioner (the outdoor unit 11 and the indoor unit 12) as a management target, the data acquired from the controller 60. The processing unit 43a further manages the air conditioner in accordance with the data stored in the storage unit 41.

The input unit 45 is an interface for input of information to the server apparatus 40. The input unit 45 is implemented by a keyboard, a mouse, and/or a touch screen, etc.

The output unit 46 is configured to output various information and is constituted by any type of a display, a speaker, and the like.

(4) Air conditioner data model

The air conditioner data model 4 is a collection of data on each type of the air conditioners 10. Each type of the air conditioners 10 indicates each model of the outdoor unit 11 or the indoor unit 12, and a different model is set for different horse power, capacity, or the like of the outdoor unit 11 or the indoor unit 12.

For example, FIG. 4 is a schematic chart indicating the air conditioner data model 4 for the indoor unit 12a. The indoor unit 12a is a single flow outdoor unit (type A), and the air conditioner data model 4 for the indoor unit 12a includes data on start and stop, set temperature, and suction temperature. FIG. 5 is a schematic chart indicating the air conditioner data model 4 for the indoor unit 12b. The indoor unit 12b is a four-way blowable cassette indoor unit (type B), and the air conditioner data model 4 for the indoor unit 12b includes data on start and

stop, set temperature, suction temperature, and a human detection state. FIG. 6 is a schematic chart indicating the air conditioner data model 4 for the indoor unit 12c. The indoor unit 12c is a floorstanding indoor unit (type C), and the air conditioner data model 4 for the indoor unit 12c includes data on start and stop, set temperature, suction temperature, and floor temperature.

5 The air conditioner data model 4 for the indoor unit 12 can obviously include any other data. Each piece of data is linked with items such as “Input/Output”, “Data Type”, and “Property (Attribute)” to indicate data on the indoor unit 12a, 12b, and 12c in more detail.

Specifically, the item “Input/Output” indicates that the data is an input value or an output value. The item “Data Type” indicates whether acquired data is analog data or binary data.

10

The item “Property (Attribute)” includes a current value indicating a current state of the air conditioner 10, an environmental state around the air conditioner 10, and a set value. The current value includes data acquired by the controller 60 from the air conditioner 10 via the connecting unit 64. A minimum value and a maximum value indicates a minimum value and a maximum value of a manageable value for the type. The minimum value and the maximum value exemplarily indicates a minimum value and a maximum value of the set temperature for the air conditioner 10. An initial value indicates a value initially set for the type. A stride indicates a stride of a manageable set value for the type. OPC indicates a communication command set for the type. Type of OPC indicates information for specification of the air conditioner 10 in accordance with the communication command. Date Converter indicates information on the conversion function used for conversion of the data item.

15

20

The information on the conversion function enables selection of one of a plurality of conversion functions stored in the controller 60. Examples of the information on the conversion function include a function ID preliminarily set for each of the conversion functions.

25

(5) Provision of air conditioner data model 4

Described hereinafter is a method of providing the air conditioner data model 4.

In the air conditioning management system 1, the controller 60 stores, in the storage unit 61, the management program 3 for management of the air conditioner 10. The manager or the like of the air conditioning management system 1 prepares the air conditioner data model 4 on an air conditioner newly introduced, and stores the air conditioner data model 4 thus prepared in the storage unit 41 of the server apparatus 40. The model is stored in the storage unit 41 of the server apparatus 40 when the manager or the like transmits the air conditioner data model 4 from a computer, a tablet terminal, or the like for the manager to the

30

communication unit 42 of the server apparatus 40 via the communication network 50 such as the Internet. When the new air conditioner data model 4 is stored (registered) at the storage unit 41, the processing unit 43a of the server apparatus 40 transmits the air conditioner data model 4 from the communication unit 42 to the communication unit 62 of the controller 60 via the communication network 50 such as the Internet. The processing unit 63a of the controller 60 stores the air conditioner data model 4 thus received in the storage unit 61. The controller 60 can thus execute the management program 3 with reference to the air conditioner data model 4. At this time, the controller 60 may acquire the conversion function as information for execution of the program.

10 (6) Execution of management program 3

The controller 60 acquires data from the air conditioner 10 via the connecting unit 64. The data thus acquired is stored in a predetermined region of the air conditioner data model 4 indicated in FIG. 4 to FIG. 6.

The server apparatus 40 communicates with the controller 60 upon receipt of a request acquired via the input unit 45 or the communication unit 42 or at intervals of predetermined time, and manages the air conditioner 10 in accordance with the air conditioner data model 4 stored in the controller 60. Managing the air conditioner 10 includes monitoring the air conditioner 10 or transmitting a command or the like to the air conditioner 10 or a different device. At this time, the processing unit 63a of the controller 60 refers to the information on the conversion function included in the air conditioner data model 4 to convert data in accordance with the conversion function. Specifically, the processing unit 63a converts data stored in the predetermined region of the air conditioner data model 4 to data recognizable by the server apparatus 40 in accordance with the conversion function included in the air conditioner data model 4.

25 (7) Features

(7-1)

The air conditioning management system 1 according to the present disclosure manages the plurality of air conditioners 10 (the outdoor unit 11 and the indoor units 12) as management targets. The air conditioning management system 1 includes the controller 60 and the server apparatus 40. The controller 60 is connected to the air conditioners 10. The controller 60 executes the management program 3 for management of the air conditioners 10. The controller 60 is connected to the server apparatus via the network. The server apparatus 40 is connected to the controller 60. The server apparatus 40 provides the controller 60 with the air conditioner data model 4 as a collection of data on the air conditioners to be referred to

in the management program 3. The air conditioner data model 4 is provided for each type of the air conditioners 10. The air conditioner data model 4 includes the information on the conversion function for interconversion between data acquired from the air conditioners and data recognizable by the server apparatus.

5 When the air conditioner data model 4 is registered at the server apparatus 40 in the air conditioning management system 1, the server apparatus 40 provides the controller 60 with the air conditioner data model 4.

10 In a conventional air conditioning management system, the management program 3 has been prepared in accordance with information (the air conditioner data model 4) unique to the air conditioners. The existing management program 3 thus prepared may occasionally fail to achieve sufficient management when a new air conditioner is introduced to the air conditioning management system. In an exemplary case where a new type of the air conditioners is introduced to the air conditioning management system, it has been necessary to develop a management program for the new type of the air conditioners. Development of a
15 management program problematically requires enormous work time and processes.

In view of this, the air conditioning management system 1 according to the present disclosure is configured as described above to start management of a new air conditioner 10 added to the air conditioning management system 1, without development of any new management program 3. Accordingly, the air conditioning management system 1 can
20 continuously manage the air conditioners 10.

The air conditioner data model 4 includes the information on the conversion function to achieve interconversion between data acquired from the air conditioners and data recognizable by the server apparatus.

(8) Modifications

25 In the air conditioning management system 1 according to the present disclosure, the controller 60 may provide the air conditioner data model 4 in the following manner.

Initially, the manager or the like of the air conditioning management system 1 prepares the air conditioner data model 4 for an air conditioner newly introduced, and stores the air conditioner data model 4 thus prepared in the storage unit 41 of the server apparatus 40. The
30 model is stored in the storage unit 41 of the server apparatus 40 when the manager or the like transmits the air conditioner data model 4 from a computer, a tablet terminal, or the like for the manager to the communication unit 42 of the server apparatus 40 via the communication network 50 such as the Internet.

Subsequently, the air conditioner is installed in one of the facilities 2, and the outdoor

unit controlling unit of the air conditioner and the connecting unit 64 of the controller 60 are connected to each other. The controller 60 acquires type information on the outdoor unit and the indoor unit of the air conditioner via the connecting unit 64. The controller 60 transmits the type information acquired from the air conditioner to the server apparatus 40 via the communication network 50, to request transmission of the air conditioner data model corresponding to the type information. When the server apparatus 40 transmits the air conditioner data model to the controller 60 in response to this request, the controller 60 is provided with the air conditioner data model for the new air conditioner.

(9)

10 The embodiment of the present disclosure has been described above. Various modifications to modes and details should be available without departing from the object and the scope of the present disclosure recited in the claims.

REFERENCE SIGNS LIST

1: air conditioning management system
15 3: management program
4: air conditioner data model
10: air conditioner
40: server apparatus
50: network
20 60: controller

CITATION LIST

PATENT LITERATURE

Patent Literature 1: JP 2004-234176 A

CLAIMS

1. An air conditioning management system (1) configured to manage a plurality of air conditioners (10) as management targets, the system comprising:
 - a controller (60) connected to the air conditioners (10) and configured to execute a management program (3) for management of the air conditioners (10); and
 - a server apparatus (40) connected to the controller (60) and configured to provide the controller (60) with an air conditioner data model (4) as a collection of data on the air conditioners (10) to be referred to in the management program (3).
2. The air conditioning management system (1) according to claim 1, wherein the controller (60) is connected to the server apparatus (40) via a network (50).
3. The air conditioning management system according to claim 1 or 2, wherein the air conditioner data model (4) is provided for each type of the air conditioners (10).
4. The air conditioning management system (1) according to any of claims 1 to 3, wherein when the air conditioner data model (4) is registered at the server apparatus (40), the server apparatus (40) provides the controller (60) with the air conditioner data model (4).
5. The air conditioning management system (1) according to any of claims 1 to 3, wherein the controller (60) acquires type data on the air conditioners (10), and the server apparatus (40) provides the controller (60) with the air conditioner data model (4) corresponding to the type data.
6. The air conditioning management system (1) according to any of claims 1 to 5, wherein the air conditioner data model (4) includes information on a conversion function for interconversion between data acquired from the air conditioners (10) and data recognizable by the server apparatus (40).

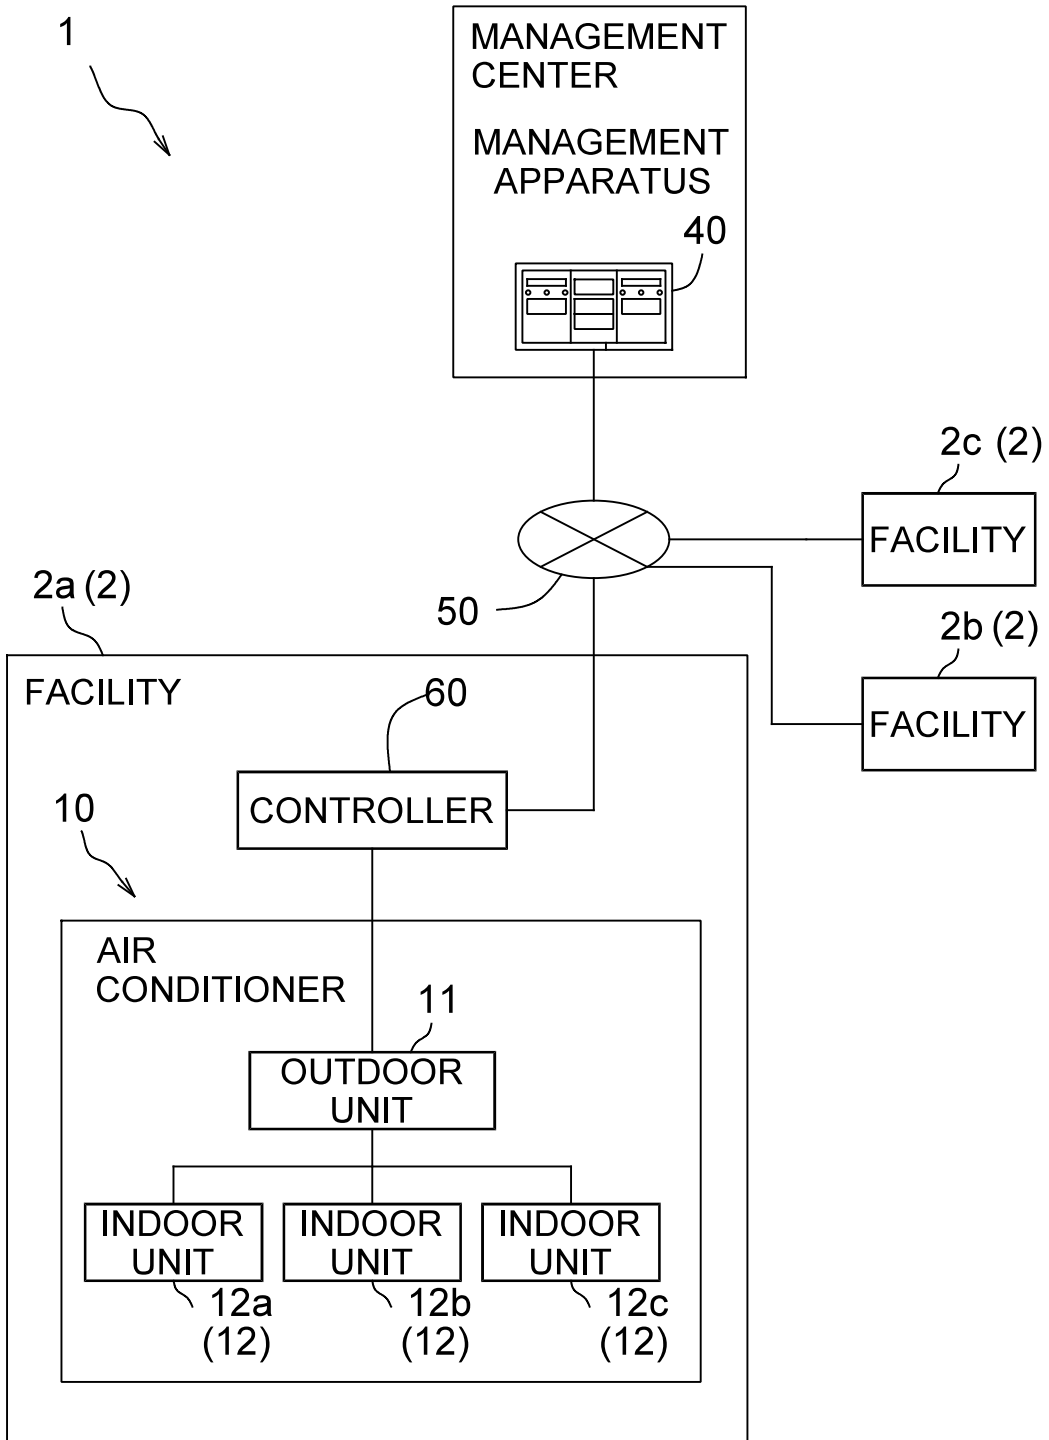


FIG. 1

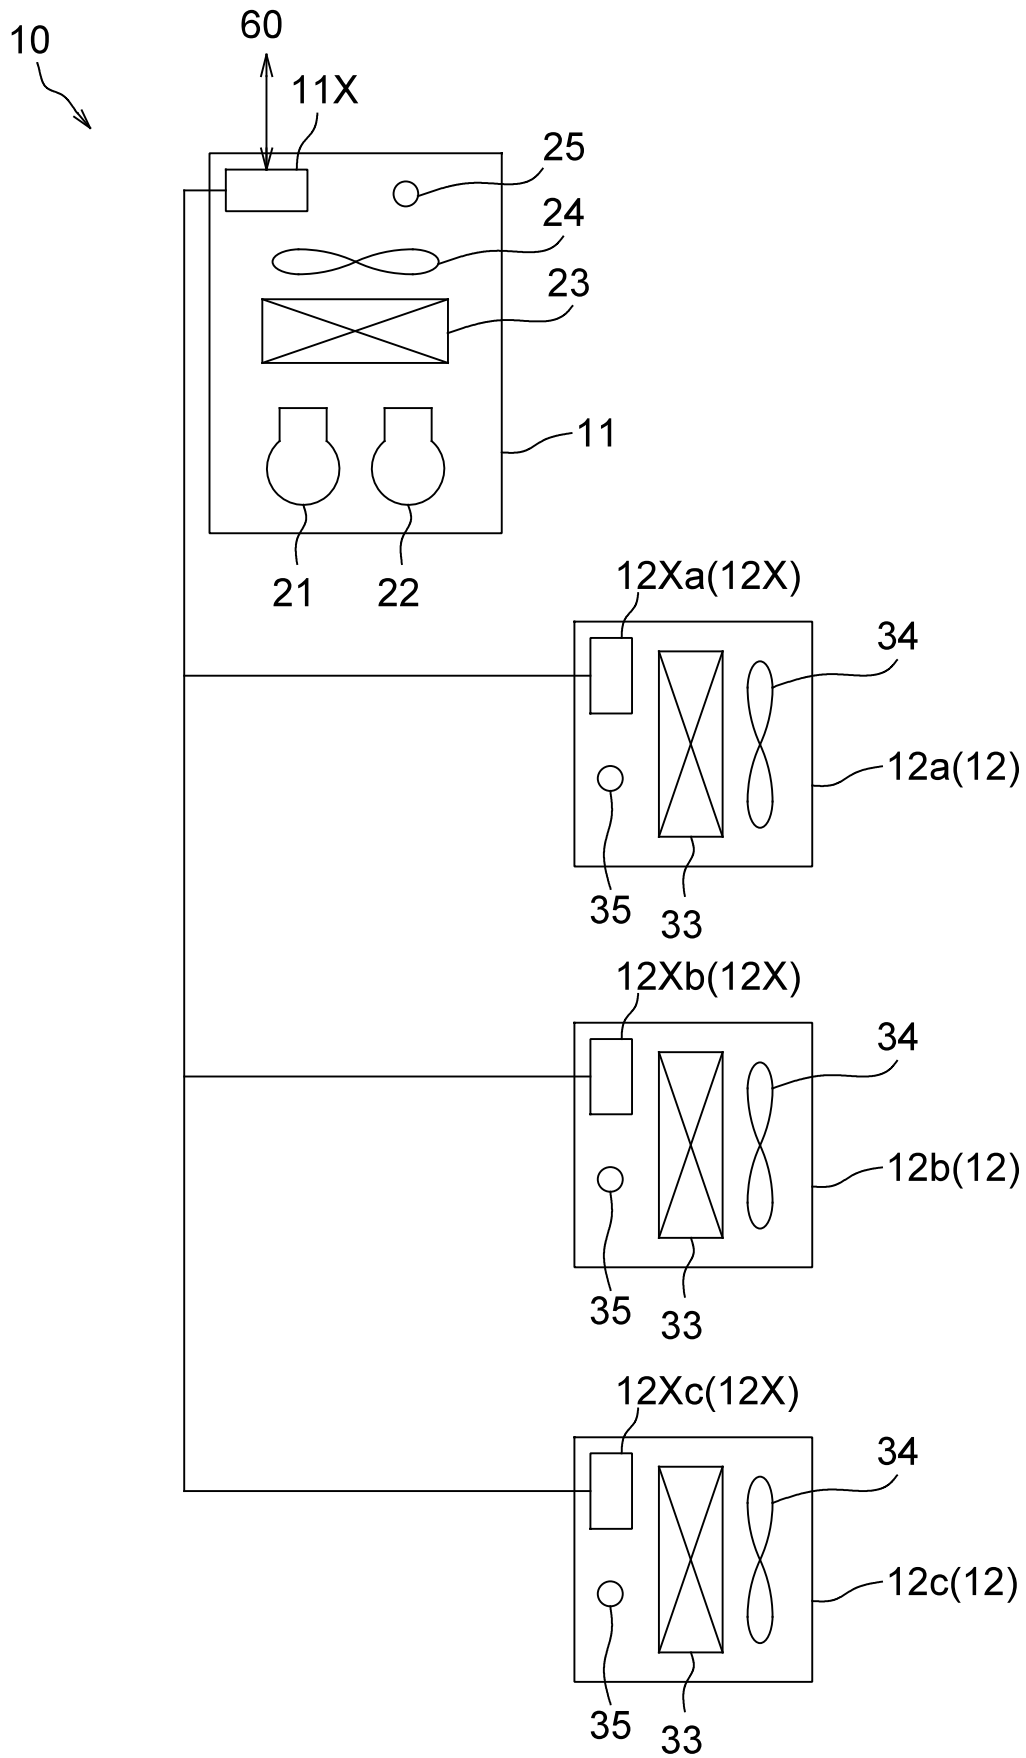


FIG. 2

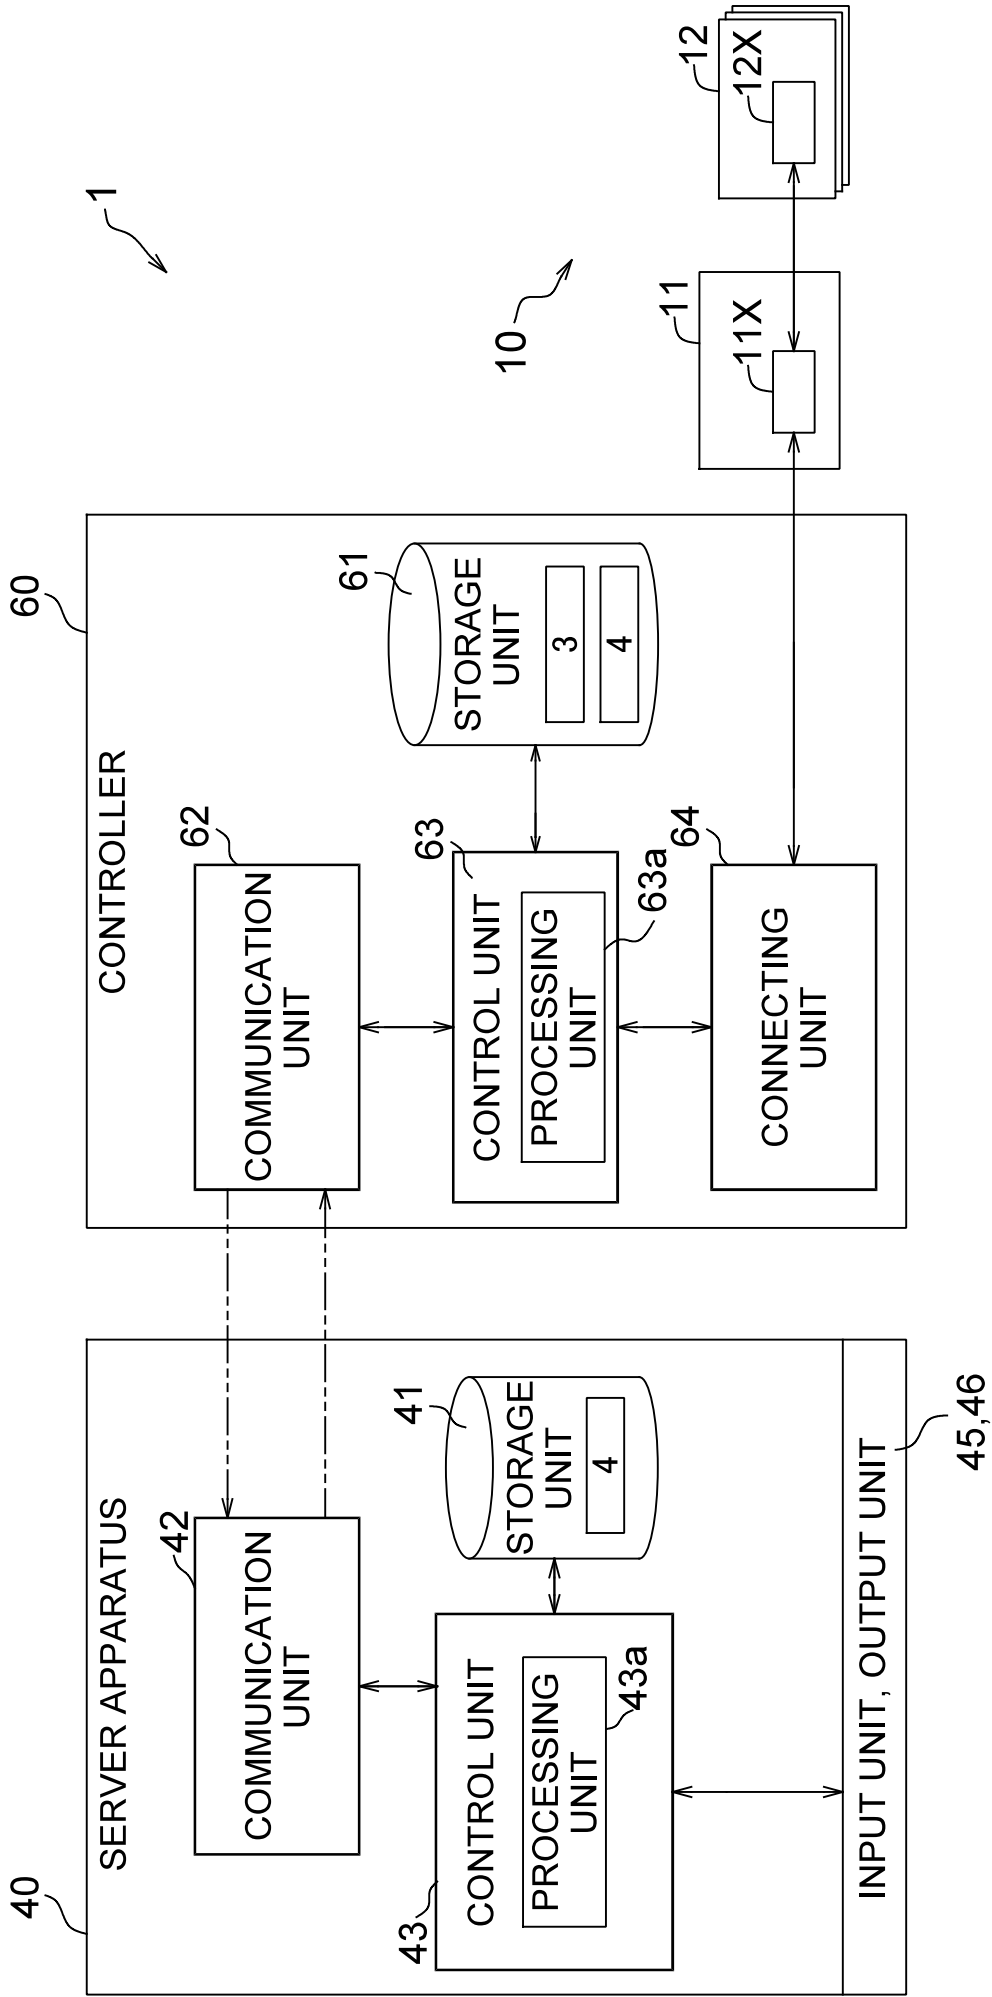


FIG. 3

12a ↗

SINGLE FLOW INDOOR UNIT

DATA ITEM	Input/ Output	Data Type	Property (ATTRIBUTE VALUE)														
			CURRENT VALUE	R/W	MINIMUM VALUE	R/W	MAXIMUM VALUE	R/W	INITIAL VALUE	R/W	STRIDE	R/W	...	OPC	Type Of OPC	Data Converter	
START AND STOP	Output	Binary	1	RW	0	R	1	R	0	R	-	-	-	-	**	-	Pattern1
	Input		1	R	-	-	-	-	-	-	-	-	-	**	-	PatternA	
SET TEMPERATURE	Output	Analog	27	RW	**	R	**	R	**	R	0.1	R	-	**	-	Pattern2	
	Input		1	R	-	-	-	-	-	-	-	-	-	**	-	PatternB	
SUCTION TEMPERATURE	Input	Analog	26	R	-	-	-	-	-	-	0.1	R	-	**	-	PatternC	

FIG. 4

12b ↙

SENSING FLOW INDOOR UNIT

DATA ITEM	Input/ Output	Data Type	Property (ATTRIBUTE VALUE)														
			CURRENT VALUE	R/W	MINIMUM VALUE	R/W	MAXIMUM VALUE	R/W	INITIAL VALUE	R/W	STRIDE	R/W	...	OPC	Type Of OPC	Data Converter	
START AND STOP	Output	Binary	1	RW	0	R	1	R	0	R	-	-	-	-	**	-	Pattern1
	Input		1	R	-	-	-	-	-	-	-	-	-	**	-	PatternA	
SET TEMPERATURE	Output	Analog	27	RW	**	R	**	R	**	R	0.1	R	-	-	**	-	Pattern2
	Input		1	R	-	-	-	-	-	-	-	-	-	-	**	-	PatternB
SUCTION TEMPERATURE	Input	Analog	26	R	-	-	-	-	-	-	0.1	R	-	-	**	-	PatternC
HUMAN DETECTION STATE	Input	Binary	0	R	-	-	-	-	-	-	-	-	-	-	**	-	PatternD

FIG. 5

FLOORSTANDING INDOOR UNIT

DATA ITEM	Input/ Output	Data Type	Property (ATTRIBUTE VALUE)													
			CURRENT VALUE	R/W	MINIMUM VALUE	R/W	MAXIMUM VALUE	R/W	INITIAL VALUE	R/W	STRIDE	R/W	OPC	Type Of OPC	Data Converter	
START AND STOP	Output	Binary	1	RW	0	R	1	R	0	R	-	-	-	**	-	Pattern1
	Input		1	R	-	-	-	-	-	-	-	-	-	**	-	PatternA
SET TEMPERATURE	Output	Analog	27	RW	**	R	**	R	**	R	0.1	R	-	-	-	Pattern2
	Input		1	R	-	-	-	-	-	-	-	-	-	**	-	PatternB
SUCTION TEMPERATURE	Input	Analog	26	R	-	-	-	-	-	-	0.1	R	-	-	-	PatternC
FLOOR TEMPERATURE	Input	Analog	17	R	**	R	**	R	**	R	-	-	-	**	-	PatternE

FIG. 6